



Shelby Energy Cooperative

®

A Touchstone Energy Cooperative



STAKING TECHNICIAN: _____

Service Specifications

Page

- 1) New Service Checklist
- 2) Electrical Inspector Contact Information
- 3) Temporary Meter Pole
- 4) UG Temporary Meter Pole
- 5) Underground Primary
- 6) Underground Meter Pedestal
- 7) Underground Service
- 8) Service Above Roof
- 9) Service Below Roof
- 10) Meter Pole Service
- 11) Electrical Load Data Sheet
- 12-13) Service Request Summary

DITCH INSPECTIONS NEED 24 HOUR NOTICE

CALL DISPATCH @ 502.633.0363

**ANY QUESTIONS REGARDING SCHEDULING OF
JOBS WHERE ALL REQUIREMENTS HAVE BEEN
MET**

**CALL JASON GINN, OPERATIONS MGR. AT
502.437.8171**



Shelby Energy Cooperative

®

A Touchstone Energy® Cooperative



CHECKLIST FOR NEW SERVICES

___ ___ Deposits required are paid.

___ ___ Advanced line fees paid.

___ ___ Other associated fees paid.

___ ___ Signed and notarized landowner easements returned to SEC.

___ ___ Signed and notarized neighboring landowner easements returned to SEC.

___ ___ Meter base installed at approved location.


___ ___ UG pipe and/ or service entrance installed per Shelby Energy spec.

___ ___ Ditch Inspection completed by Shelby Energy.

___ ___ State Electrical Inspection completed and faxed/emailed to Shelby Energy



Shelby Energy Cooperative

A Touchstone Energy Cooperative 

KENTUCKY STATE ELECTRICAL INSPECTORS

Shelby/Anderson/Franklin Counties

Inspector: Craig Bitzer

Phone#: 502-829-0054 (**Call between 6:30 – 8:00 a.m. on M-W-F**)

Henry/Oldham/Trimble/Carroll Counties

Inspector: Jerry Dunnaway

Phone#: 502-643-6168

Spencer County


Inspector: Steve Clark

Phone#: 502-477-3275

502-477-3218

TEMPORARY METER POLE

- 1** 12 FT. MINIMUM ATTACHMENT HEIGHT FOR SPACES AND WAYS SUBJECT TO PEDESTRIAN OR RESTRICTED TRAFFIC. 16 FT. MINIMUM CLEARANCE ABOVE DRIVEWAYS, PARKING LOTS, ALLEYS, CULTIVATED OR GRAZING, OR OTHER LAND TRAVERSED BY VEHICLES.
- 2** TEMPORARY POLE TO BE CONSTRUCTED OUT OF 2) 2"X6"X 15' FORMING A TEE OR 1) 4"X6"X 15' POST. IF THE TEMPORARY SERVICE IS TO BE LONGER THAN 50 FT, A 6"X6"X 15' POST WILL BE REQUIRED. NO TEMPORARY SERVICE SHALL EXCEED 75 FT. IN LENGTH.
- 3** REQUIRED MATERIALS MUST BE FURNISHED BY THE CONSUMER AND/OR ELECTRICIAN AND MUST MUST BE INSTALLED PER THE NATIONAL ELECTRIC CODE AND SHALL BE INSPECTED BY THE COUNTY APPOINTED STATE ELECTRICAL INSPECTOR.
- 4** TEMPORARY METER POLE IS TO BE INSTALLED WHERE STAKED BY SHELBY ENERGY REPRESENTATIVE

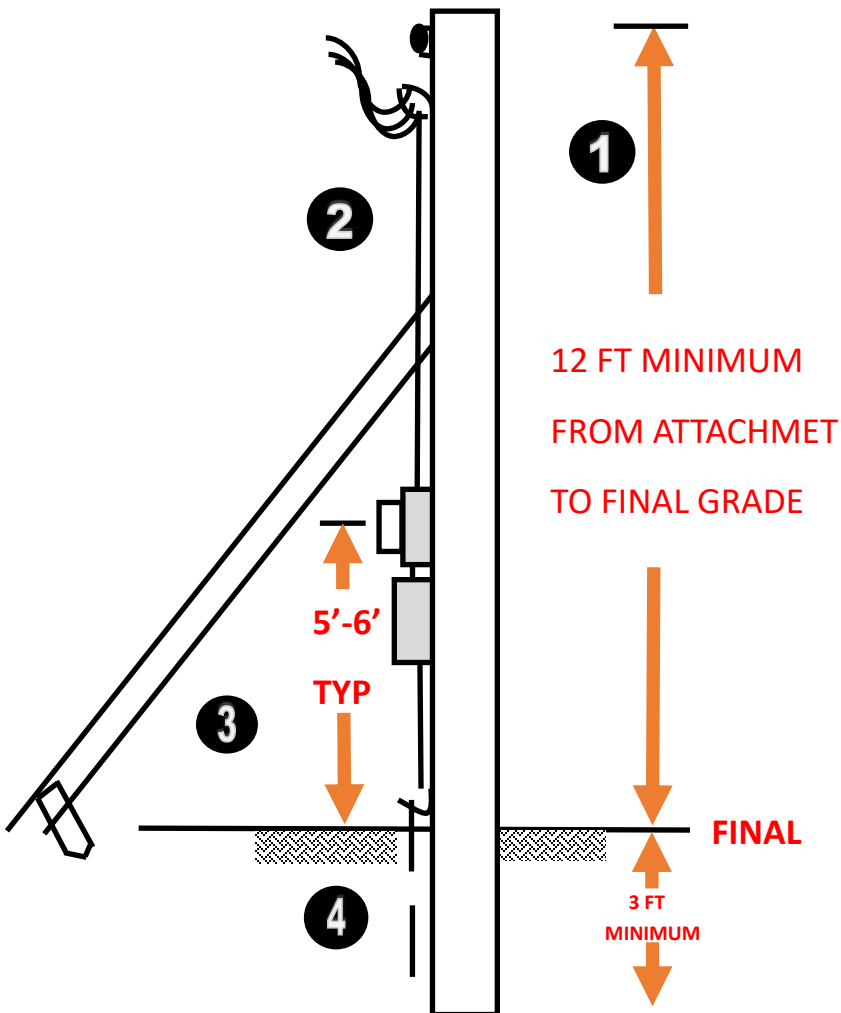


Shelby Energy
Cooperative

® A Touchstone Energy Cooperative


UG TEMPORARY METER POLE

- 1** TEMPORARY METER POLE IS TO BE LOCATED WITHIN 24" OF PADMOUNT TRANSFORMER/ SECONDARY PEDESTAL. IT SHALL BE LOCATED ON THE RIGHT SIDE OF THE TRANSFORMER/ PEDESTAL. (RIGHT SIDE IF FACING THE LOCK) THERE SHOULD BE A MINIMUM OF 6' OF CABLE FOR SHELBY ENERGY TO MAKE THE CONNECTION.
- 2** REQUIRED MATERIALS MUST BE FURNISHED BY THE CONSUMER/ ELECTRICIAN AND MUST BE INSTALLED PER THE NATIONAL ELECTRIC CODE AND SHALL BE INSPECTED BY THE APPOINTED STATE ELECTRICAL INSPECTOR.
- 3** ALL MATERIALS ARE TO BE MOUNTED TO 1) 2"X6"X8' OR 1) 4"X4"X8" POST.

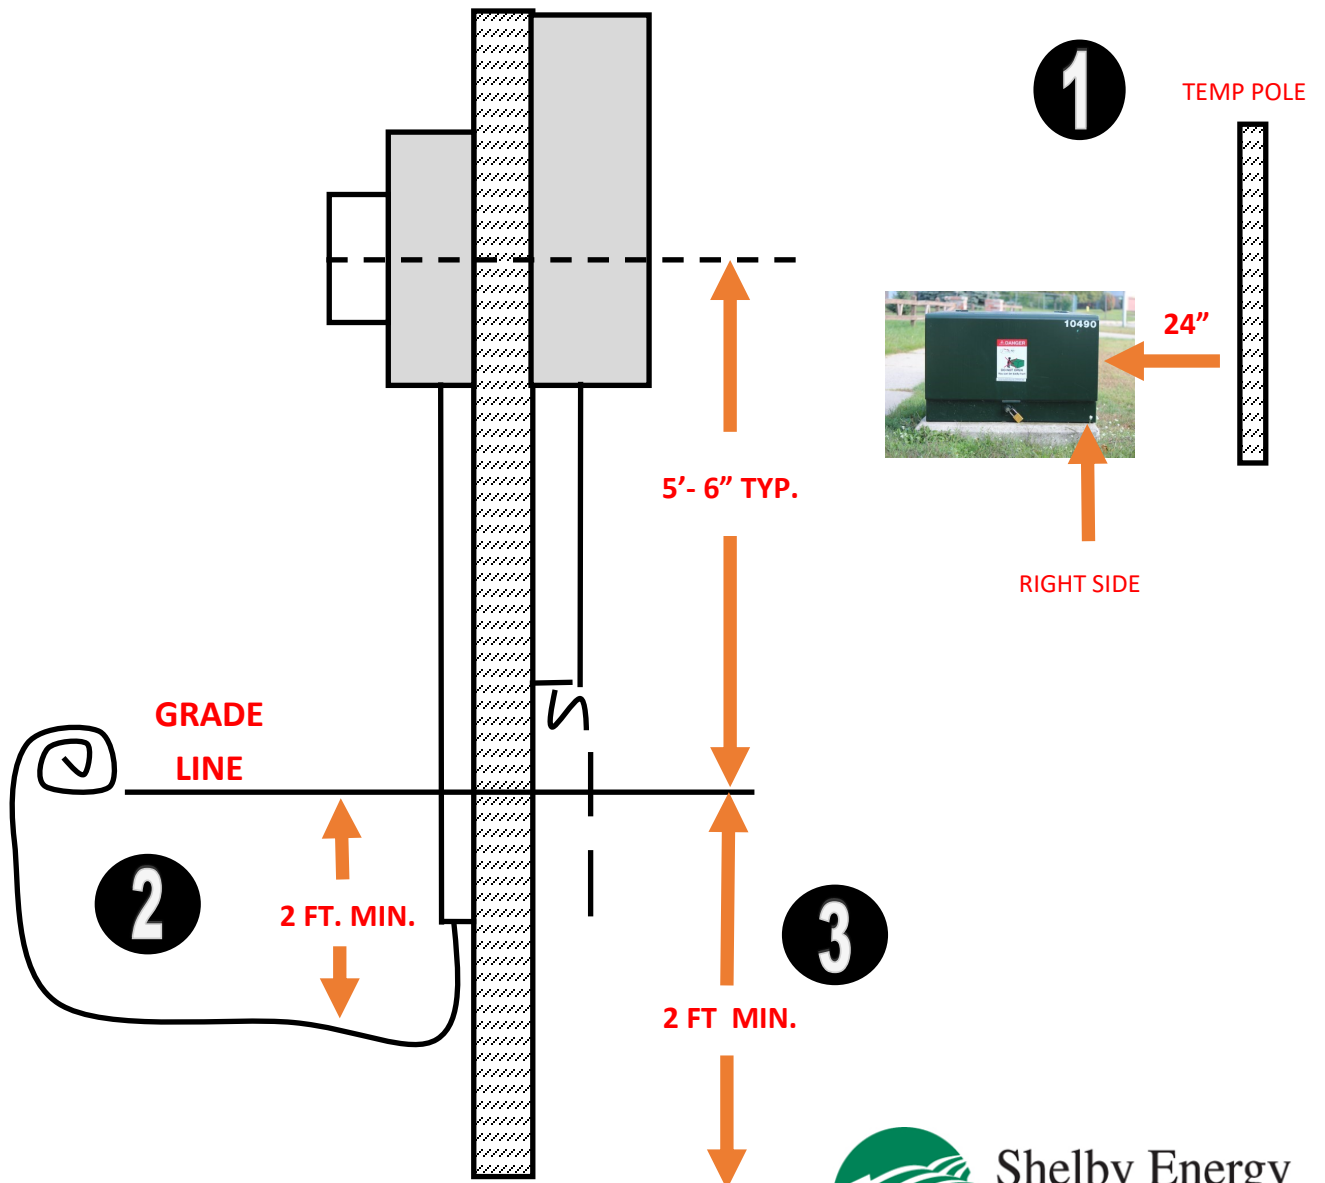

UNDERGROUND PRIMARY

- 1) SHELBY ENERGY COOPERATIVE TO APPROVE PADMOUNT TRANSFORMER AND/OR PULL BOX LOCATIONS.
- 2) CONDUIT TO BE FURNISHED AND INSTALLED BY CONSUMER, INCLUDING A CONDUIT PULL ROPE.
- 3) TRENCH TO BE LEFT OPEN FOR SHELBY ENERGY COOPERATIVE TO INSPECT. PLEASE REFER TO TRENCHING AND CONDUIT SPECIFICATIONS BELOW.

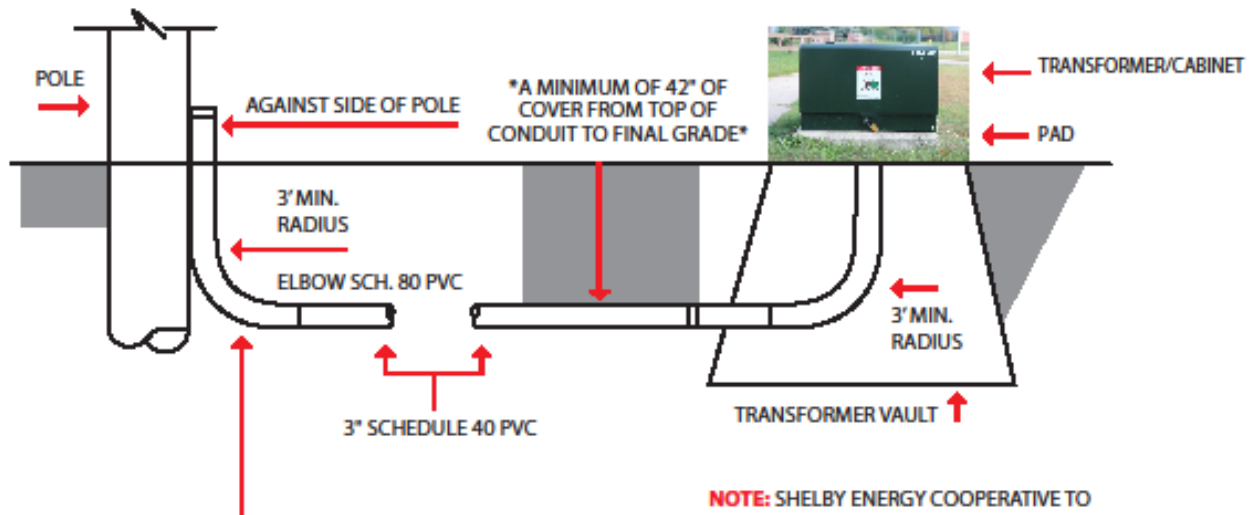

ALL PRIMARY TO BE CONSTRUCTED WITH ONLY ELECTRICAL 90° ELBOWS and 45° ANGLE FITTINGS, SHALL BE NO MORE THAN 3-90° ELBOWS OR COMBINATION THEREOF. FOR EXAMPLE, 1-90 AT THE HOUSE, 1-90 AT THE POLE OR TRANSFORMER, 1-90 or 2-45's CAN BE INSTALLED IN THE REMAINING CONDUIT. ALL RISER ELBOWS TO BE SCH. 80 PVC.

NOTE: SHELBY ENERGY COOPERATIVE TO FURNISH AND INSTALL TRANSFORMER VAULT AND/OR FEED-THRU PULL BOXES, AFTER CONDUIT HAS BEEN INSTALLED.

IMPORTANT: SHOULD TRENCH LENGTH EXCEED 500' AND/OR HAVE CHANGES IN TERRAIN, AND DIRECTION THAT PREVENTS ADEQUATE INSTALLATION OF COOPERATIVE FACILITIES, THEN FEED-THRU/PULL BOXES MAY BE ADDED INTERMITTENTLY ALONG TRENCH ROUTE AS DETERMINED BY YOUR SHELBY ENERGY COOPERATIVE.



Shelby Energy Cooperative

A Tennessee Energy Cooperative

UNDERGROUND METER PEDESTAL

1

CONSTRUCTED WITH 2) 6"X6" TREATED POSTS, BOLTED TOGETHER AND SET IN THE GROUND 3 FEET.

2

METER BASE SHOULD BE MINIMUM OF 5 FEET ABOVE GROUND WITH MAXIMUM OF 6 FEET ABOVE GROUND. DISCONNECT/ BREAKER PANEL CAN BE MOUNTED BELOW OR ON OPPOSITE SIDE OF PEDESTAL.

3


MATERIALS ARE TO BE PROVIDED AND INSTALLED BY THE MEMBER/ ELECTRICIAN PER THE NATIONAL ELECTRIC CODE AND MUST BE INSPECTED BY THE COUNTY APPOINTED STATE ELECTRICAL INSPECTOR.

4

SUPPLY CONDUIT MUST BE A MINIMUM OF 30" DEEP FROM FINAL GRADE.



Know what's below.
Call before you dig.

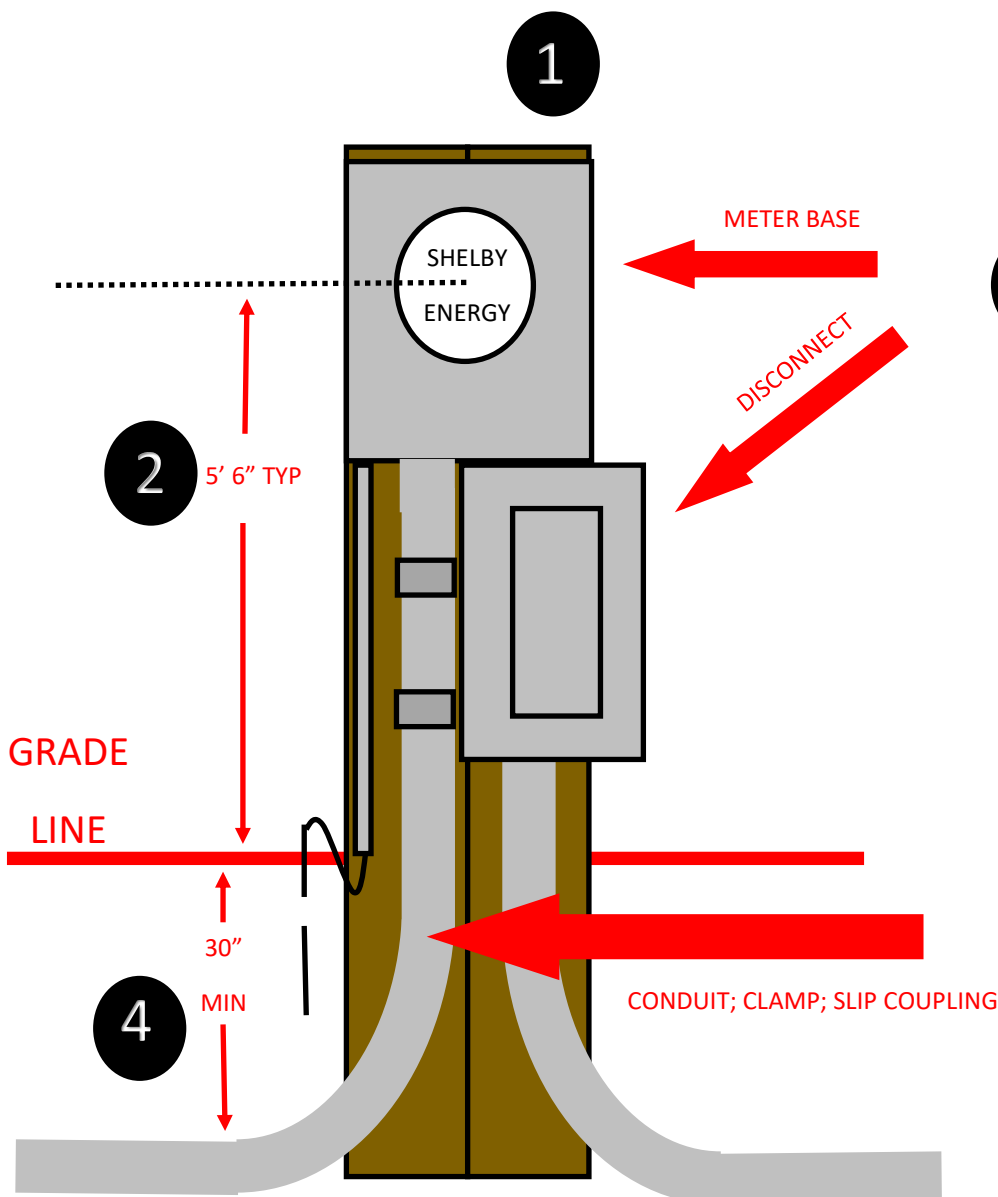


Shelby Energy
Cooperative

® A Touchstone Energy Cooperative

UNDERGROUND SERVICE

- 1) SHELBY ENERGY COOPERATIVE TO APPROVE METER BASE LOCATION.
- 2) SERVICE NEUTRAL, METER BASE MUST BE PERMANENTLY GROUNDED IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE.
- 3) CONDUIT TO BE FURNISHED AND INSTALLED BY CONSUMER, INCLUDING PULL ROPE.
- 4) METER BASE TO BE OBTAINED, INSTALLED AND ADEQUATELY SECURED BY CONSUMER. A SLIP COUPLING SHALL BE INSTALLED ON THE CONDUIT WITH 1 THROUGH THE WALL RISER CLAMP ABOVE THE SLIP COUPLING.
- 5) **CHANGES IN CONDUIT DIRECTION: CONTACT STAKING TECHNICIAN FOR ADVICE**
- 6) CONTACT SHELBY ENERGY TO HELP INSTALL ELBOW IN EXISTING TRANSFORMER, VAULT, OR PEDESTAL

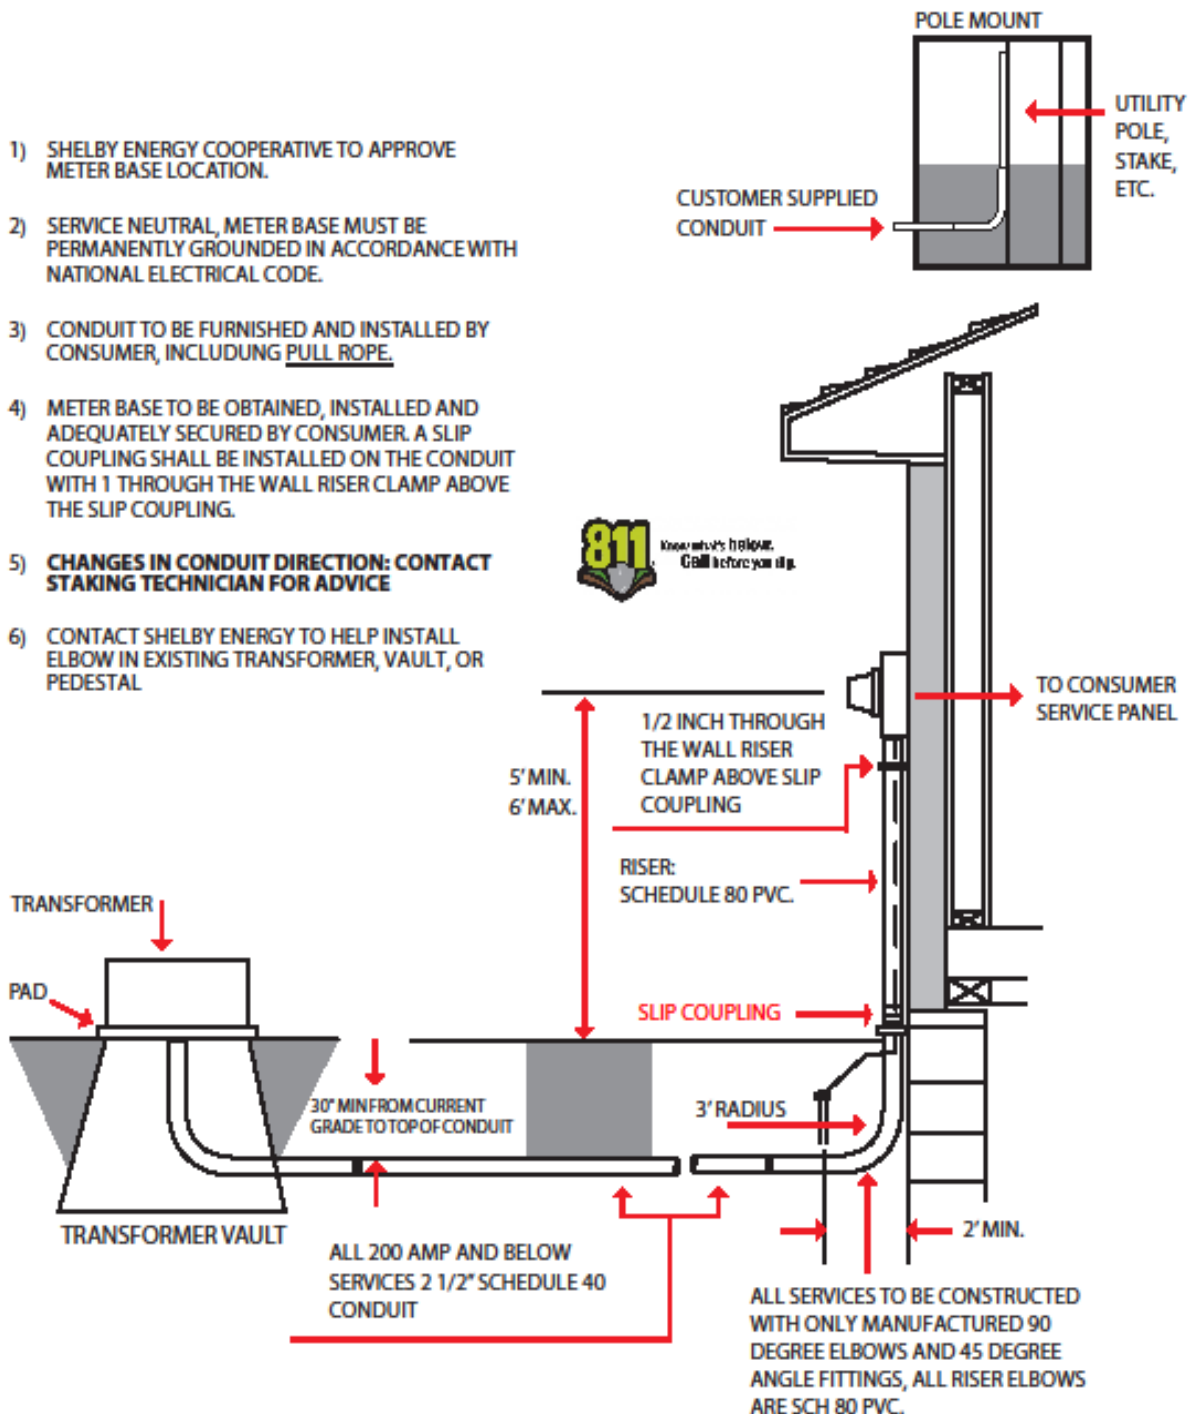

IMPORTANT: SHOULD TRENCH LENGTH EXCEED 150' OR SERVICE ENTRANCE SIZE BE LARGER THAN 200 AMP, CONSULT WITH SHELBY ENERGY COOPERATIVE FOR SPECIAL DESIGN.




Shelby Energy Cooperative

A Touchstone Energy Cooperative

Service Above Roof


A SERVICE MAST IS REQUIRED WHEN IT IS NOT POSSIBLE TO MAINTAIN 12-FT. CLEARANCE FROM FINISHED GRADE TO ATTACHMENT POINT. VERTICAL CLEARANCE OF CONDUCTOR TO ROOF SURFACE DEPENDS ON THE SLOPE OF THE ROOF. (SEE NEC 230-24 (A))

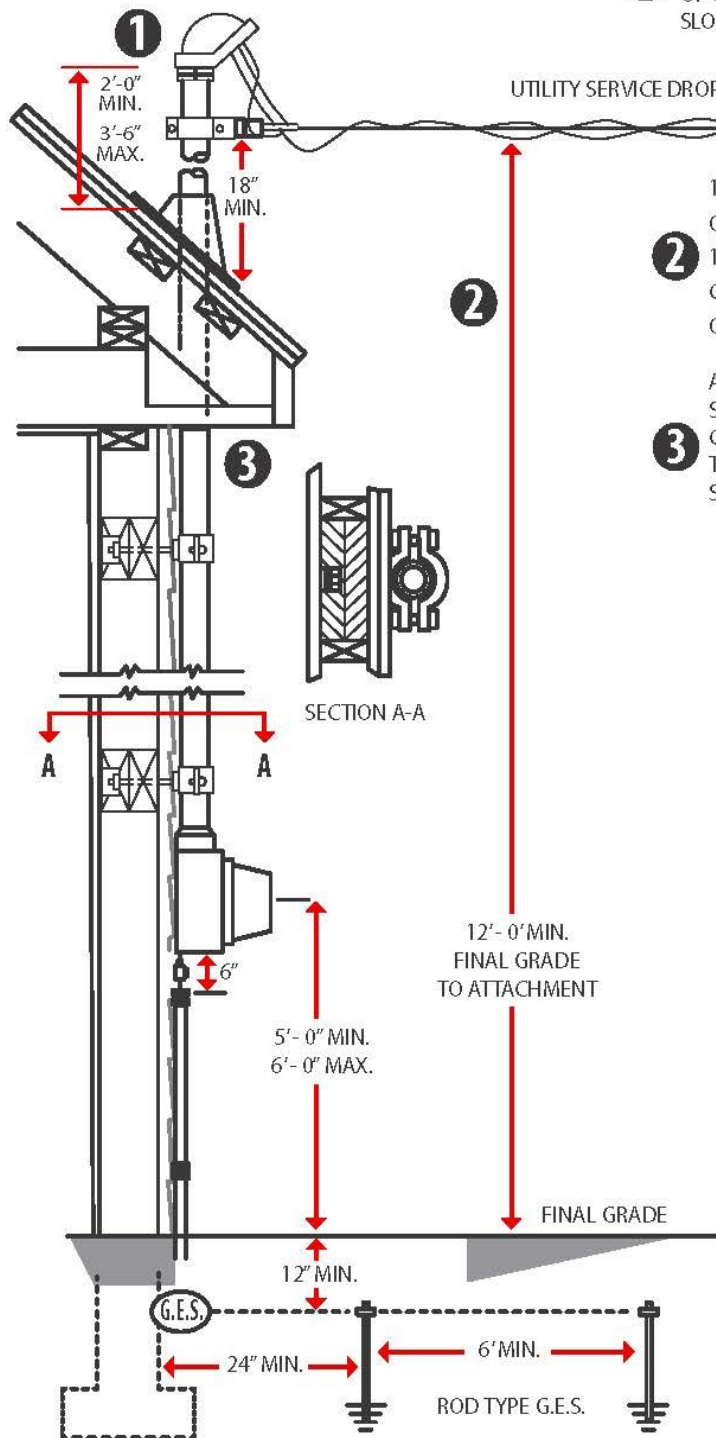

Shelby Energy Cooperative

® A Touchstone Energy Cooperative

OVERHEAD SERVICE BELOW ROOF

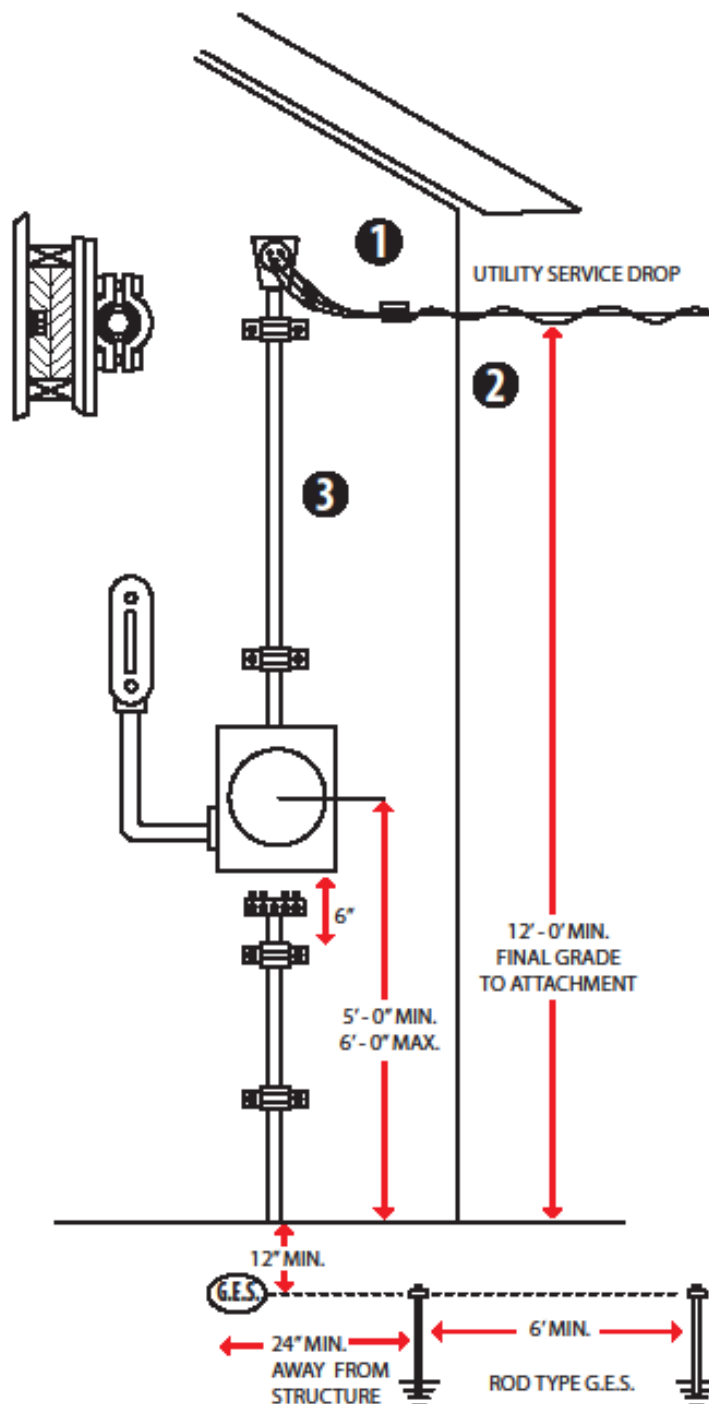

- 1) SERVICE ATTACHMENT POINT SHOULD BE NO MORE THAN 2 FEET FROM THE WEATHERHEAD AND INSTALLED BY THE ELECTRICIAN TO ATTACH UTILITY SERVICE DROP. (SEE UTILITY FOR LOCATION)
- 2) 12 FT. MIN. FOR SPACES AND WAYS SUBJECT TO PEDESTRIAN OR RESTRICTED TRAFFIC
16 FT. MINIMUM ABOVE DRIVEWAYS, PARKING LOTS, ALLEYS, CULTIVATED OR GRAZING AREAS, OR OTHER LAND TRAVERSED BY VEHICLES
- 3) MIN. CONDUIT SIZE: CONTACT UTILITY



Direct Wire Type to Service Pole



10



Shelby Energy Cooperative

A Touchstone Energy Cooperative

Electrical Load Data Sheet

620 Old Finchville Rd
Shelbyville Ky 40065
(502) 633-4420

Facility Name: _____ Date: _____
Address: _____ City/State/Zip: _____
Directions: _____

Electric Service Data

Service Request Type: ☐ New Construction ☐ Existing ☐ Electric Overhead Conversion to Underground
Type of New Service: ☐ Residential ☐ Commercial ☐ Agriculture
Anticipated Service Date: _____ Temporary Electric Service: ☐ Yes ☐ No Date Needed: _____
Electric Service Type: ☐ Overhead ☐ Underground
Entrance Size (Amps): _____ Conduit #/Dia.: _____/_____ Conductor #Sets/Size: _____/_____ (AWG/kcm)
Metering Comments: _____
Facility Has a Total of _____ sq-ft of Floor Area on _____ Floors of Which _____ sq-ft are air-conditioned
Basement/Attic/Other Living Space Not Included Above: ☐ Yes ☐ No (_____ sq-ft finished, _____ sq-ft unfinished)
Facility Heated With: ☐ Gas ☐ Electric Facility has _____ Tons of Cooling Capacity

Voltage & Load Data

Service Requested		Available Service			1-Phase kW	3-Phase kW
Voltage/Type		OH	UG			
<input type="checkbox"/>	120/240V 1-Phase, 3-wire	Yes	Yes	Connected Loads	Space Heating	_____
<input type="checkbox"/>	120/208V 3-Phase, 4-wire	Yes	Yes		A/C - Heat Pump	_____
<input type="checkbox"/>	120/240V 3-Phase, 4-wire	Yes	No		Air Handlers	_____
<input type="checkbox"/>	277/480V 3-Phase, 4-wire	Yes	Yes		Lighting	_____
<input type="checkbox"/>	Other: _____				Water Heating	_____
<input type="checkbox"/>	Based on your experience and load data, estimate what you believe the true total peak kW Demand will be _____ kW.				Cooking	_____
					Refrigeration	_____
					Welding**	_____
					Misc/Receptable	_____
					Total	_____

Data for the Largest Motor

HP: _____ Voltage: _____ Phase: _____ FLA: _____ LRA: _____
Reduced Voltage Starting: ☐ Yes ☐ No If yes, describe: _____


Contact Information

Responsible Party (sign below) Phone: _____ **Electrical Contractor** Phone: _____
Name: _____ Name: _____
Address: _____ Address: _____

Comments/Additional Information

Comments: _____

Submitted by: _____ Date: _____

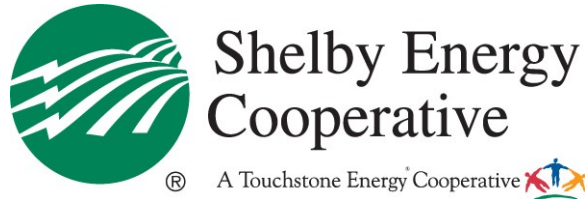

Service Request Summary

Location _____

Work Order _____

Per Section 32; Section 1; Paragraphs A-C of Shelby Energy Cooperative's Rules and Regulations

Approval shall be obtained from the Cooperative as to the proper location for a service entrance. Service entrances will be located on the exterior of the building nearest to the Cooperative's lines. For members desiring service entrances on any building at a location other than that closest to the Cooperative's lines, the additional estimated cost of such special construction as may be found necessary shall be borne by the member, and such cost shall be paid in advance before service can be connected.

Service entrances, both overhead and underground, shall be installed in accordance with applicable codes, and the Cooperative shall not connect until the required certificate of compliance has been issued by the required certified electrical inspector. In event of an emergency, a temporary waiver may be issued by the Cooperative to allow connection pending completion of electrical inspection.

The undersigned, _____, has met with a Cooperative representative, _____, concerning work to be completed on their property. The attached sketch depicts all agreed upon locations. **Member or member representative must call Staking Technician to set up all ditch inspections and again when ready for permanent service.**

Member Signature

Date

Shelby Energy Representative

Date

ROUGH SKETCH OF WHERE METER BASE SHOULD BE LOCATED ON STRUCTURE

Standard Check-list Requirements:

- ☐ Easements ☐ Advance Line Fee ☐ Construction in Aid ☐ Underground Ditch Inspection(s)
☐ Specifications ☐ Other: _____

Initials _____